

# PRO-T ARCHITECTURAL SHOP DRAWING

Date: \_\_\_\_\_

Page: \_\_\_\_\_ of \_\_\_\_\_

Drawing No.: \_\_\_\_\_

Architect/ Engineer: \_\_\_\_\_

Contractor: \_\_\_\_\_

Customer: \_\_\_\_\_

Number of Operators: \_\_\_\_\_

Horsepower: \_\_\_\_\_

Volts: \_\_\_\_\_

Phase: \_\_\_\_\_

Hertz: \_\_\_\_\_

Type of Door: \_\_\_\_\_

Door Width/ Height: \_\_\_\_\_ W x \_\_\_\_\_ H

Operator Nema Rating: \_\_\_\_\_


OPEN/ CLOSE/ STOP Control Stations: \_\_\_\_\_

**FULL LOAD AMP RATING CHART (AMPS)**

VOLTAGE	1/3 HP	1/2 HP	3/4 HP
110V 1-Φ, 60 HZ	7.9	8.5	11.6
230V 1-Φ, 60 HZ	3.9	4.2	6.0
230V 1-Φ, 50 HZ	3.1	3.1	5.6
208/230V 3-Φ, 60 HZ	2.1	2.1	2.8
380V 3-Φ, 50 HZ	1.1	1.1	1.4
460V 3-Φ, 60 HZ	1.1	1.1	1.5
575V 3-Φ, 60 HZ	1.0	1.0	1.2

Control Wiring Option: \_\_\_\_\_

- A** Relay Logic w/ interface module (monitored reversing device supplied)
- B** Smart 10.0 logic board (monitored reversing devices supplied)
- C** Relay Logic (not available in US or other areas where UL325 is mandated)

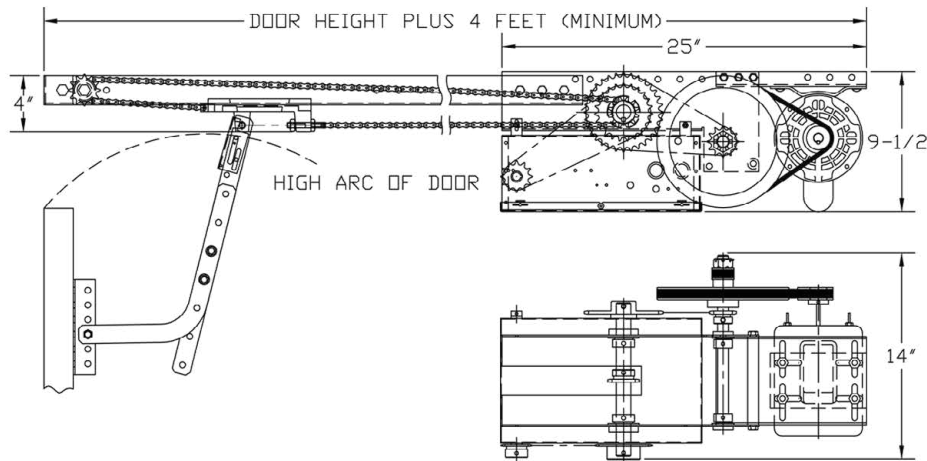

**ADDITIONAL EQUIPMENT OR OPTIONS**

---



---



---